




# ONE SOLUTION™




Only the room controller is shown in this example sensors and switches are excluded for clarity.

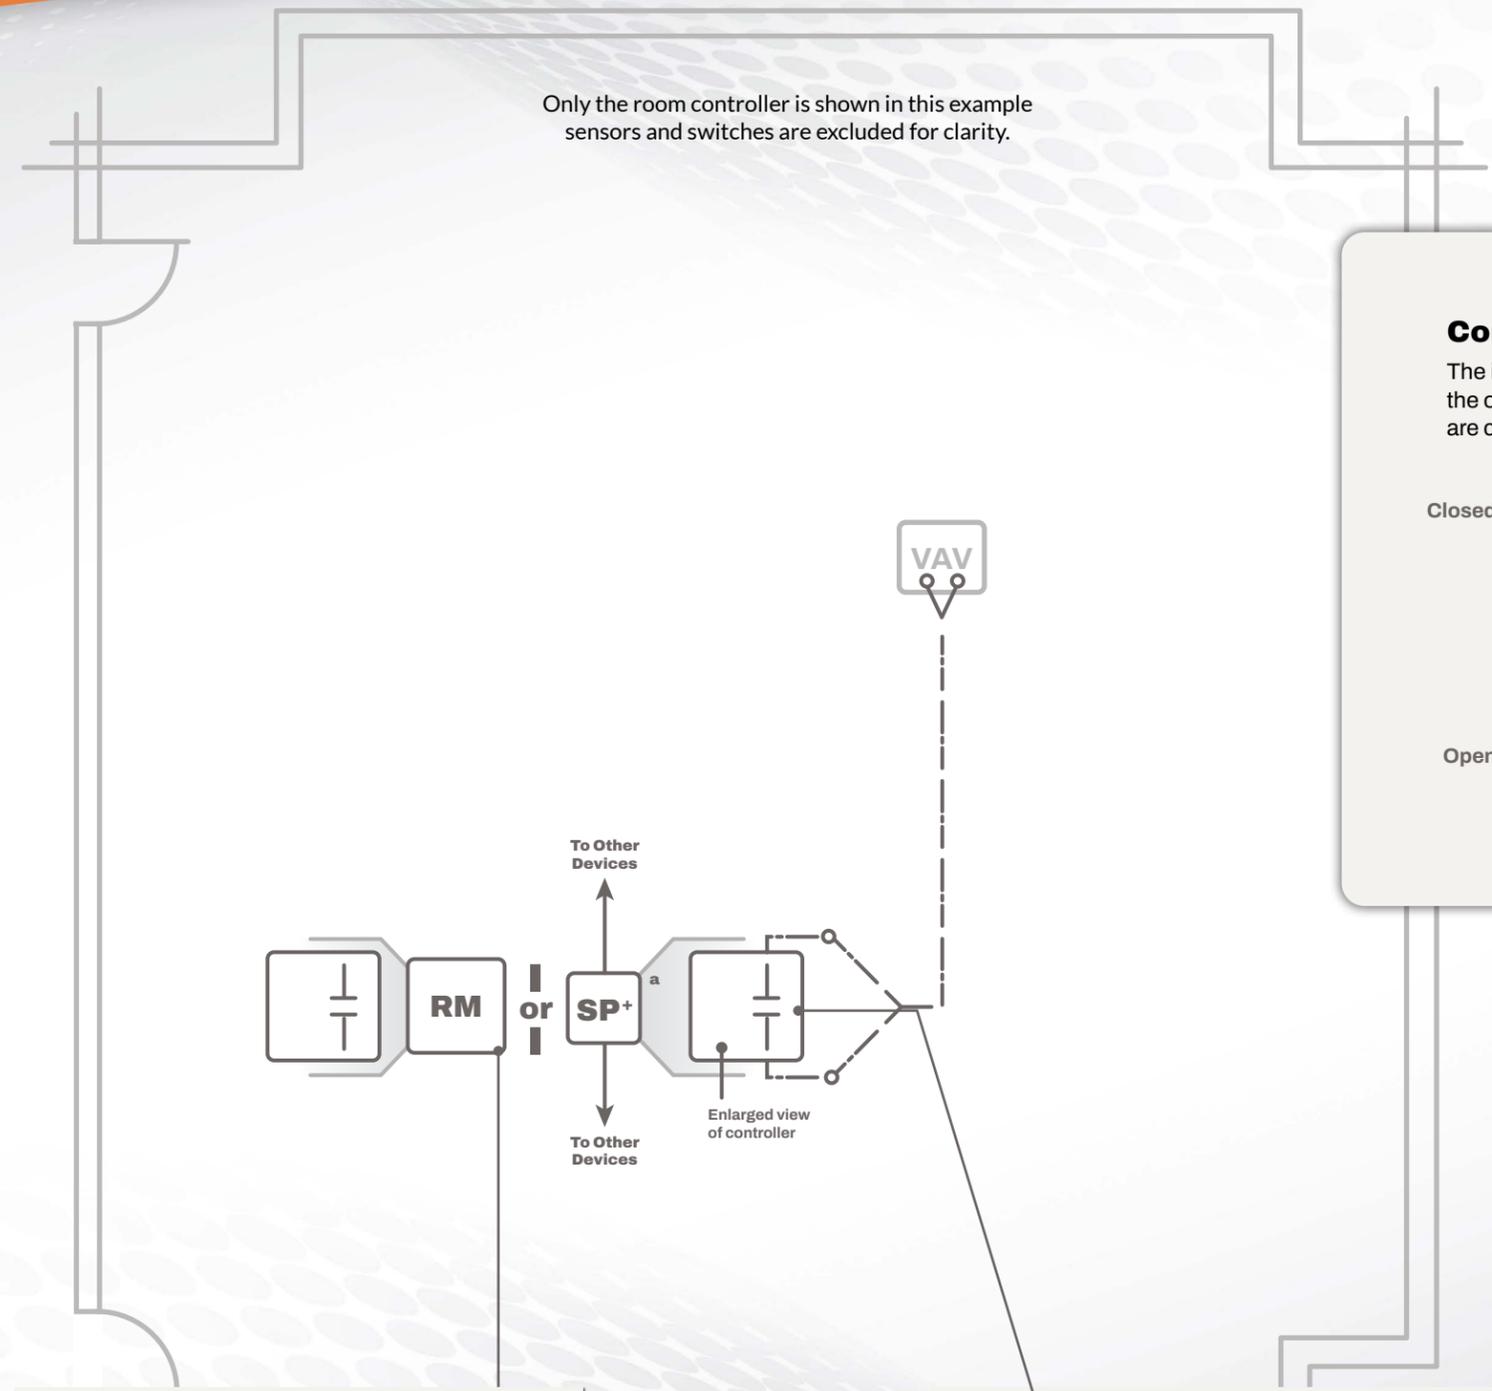

### Contact Closure BMS/HVAC Integration

The integration contacts of the SmartPack and/or Room Manager, follow the occupancy state of the room. When the room is occupied, the contacts are closed and when the room is vacant the contacts are open.

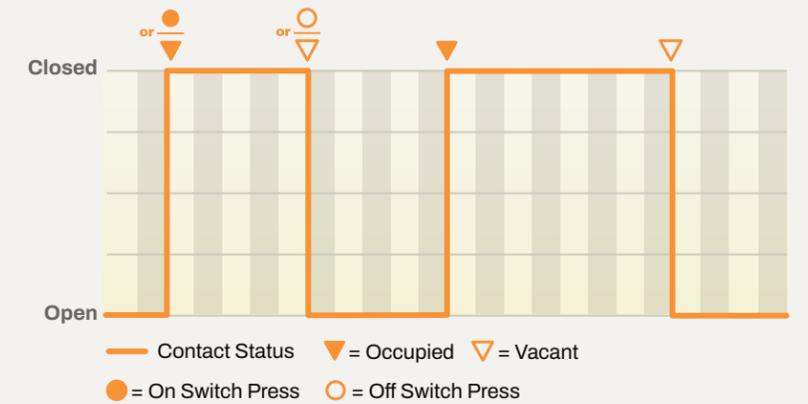

### Touché Components

- RM** Room Manager  
Networked Room Controller
- SP+** SmartPack Plus  
Standalone Room Controller

### Cable Type

----- CAT5 (minimum)

**Alternate HVAC Integration Option**  
If using a networked Room Manager, BMS/HVAC integration can be accomplished utilizing the Room Manager's built-in BACnet/IP standard capability.

**Alternate HVAC Integration Option**  
If using a networked Room Manager, BMS/HVAC integration can be accomplished utilizing the Room Manager's built-in BACnet/IP standard capability.