


LED INFORMATION

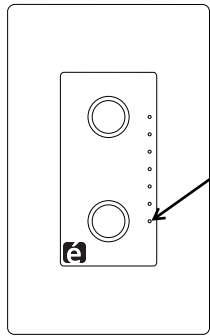


FLASHING  
GREEN LED

COMMUNICATION ERROR

ISSUE - POWER AND NO  
COMMUNICATION

- VERIFY CABLING TERMINATION  
COLOR CODING

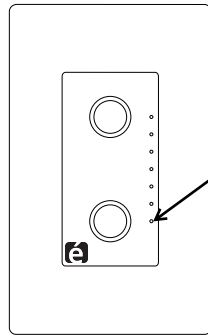


SOLID  
RED LED

PORT ERROR

ISSUE - PLUGGED INTO BRANCH  
PORT

- CONNECT TO SMART PORT

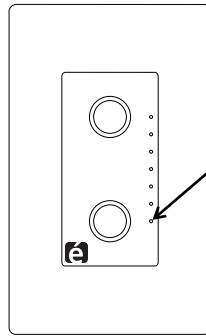

SOLID  
BLUE LED

DEFAULT

CLEANING INSTRUCTIONS



SYMBOLS AS SHOWN  
ON SUBMITTAL AND  
CONSTRUCTION  
DOCUMENTS

**ALWAYS**

- USE ONLY TOUCHSCREEN SAFE CLEANER AND CLEAN MICROFIBER

CLOTH

- DAMPEN THE CLEAN MICROFIBER CLOTH AND WIPE SWITCH
- WIPE THE SWITCH DRY WITH A CLEAN MICROFIBER CLOTH

**NEVER**

- USE GLASS CLEANER
- SPRAY SWITCH DIRECTLY WITH CLEANER
- USE PAPER TOWELS



**FAILURE TO FOLLOW THESE INSTRUCTIONS WILL DAMAGE THE SWITCH AND VOID THE PRODUCT WARRANTY**

TIPS / NOTES


- MINIMUM CAT 5 CABLE - ENSURE CABLES ARE PLUGGED INTO SMART PORTS OF ROOM MANAGERS, SMARTPACK PLUSSES, OR SMARTPACKS  
DO NOT CONNECT TO BRANCH PORTS
- MOUNT TO SINGLE GANG JUNCTION BOX OR 4 SQUARE BOX WITH SINGLE GANG MUD RING


**CONNECTIVITY DIAGRAM**

**PART # SS-2B**



SYMBOLS AS SHOWN  
 ON SUBMITTAL AND  
 CONSTRUCTION  
 DOCUMENTS

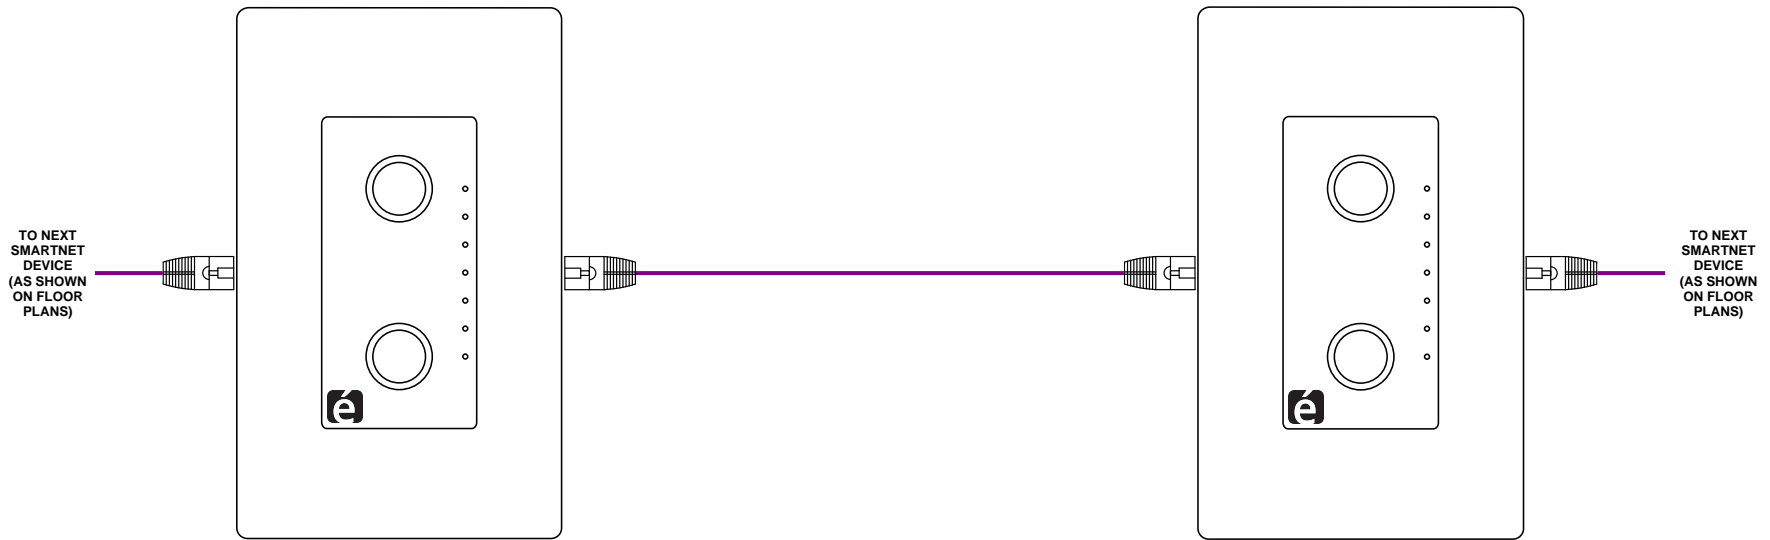

CABLE TYPES			
LINE ID	DESCRIPTION	TYPE	NOTES
	SMART	CAT 5 (MIN)	TOTAL SMARTNET LENGTH NOT TO EXCEED 400'